



PLAN VIEW

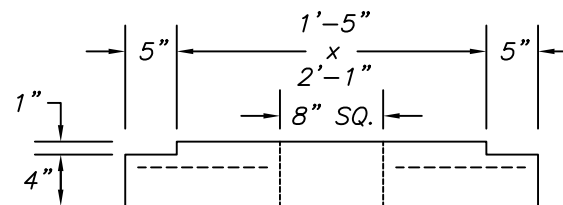

BASE SECTION

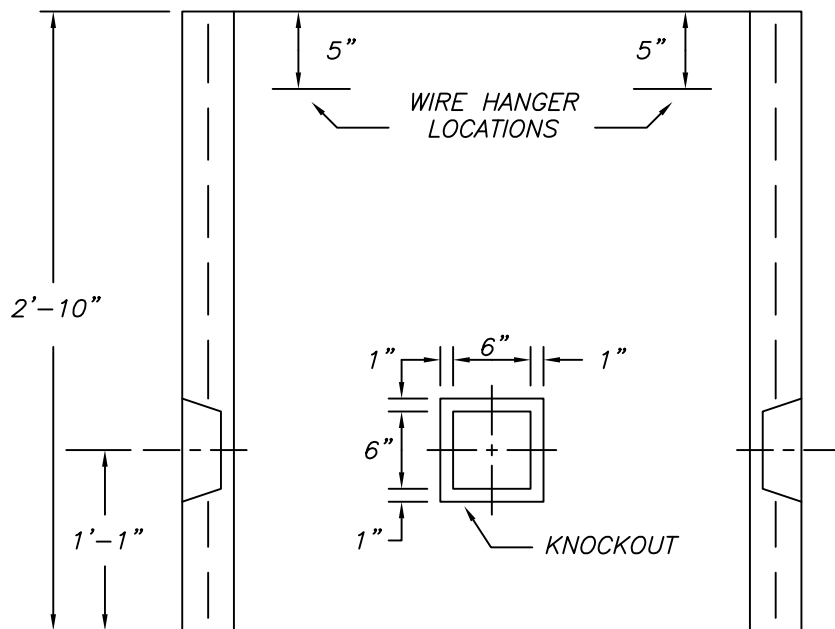

SECTION

NOTES :

- * PULL BOXES REQUIRE BASE SLABS WHEN PLACED IN PAVEMENT OR SHOULDER OF ROADWAY.
- * BASES WHEN REQUIRED CAN BE CAST INTRAGRAL WITH PULL BOX.
- * REINFORCEMENT - MINIMUM .012 SQ. IN. / FT.
- * ALL WALL KNOCKOUTS ARE 6" x 6" TAPERED.
- * CONCRETE TO TEST 4000 PSI @ 28 DAYS

Precast Concrete Sales Co.

123 Route 303 Valley Cottage , N.Y. 10989
Tel. (845) 268-4949 - Fax (845) 268-4376

CONT.

JOB

PULL BOX-18"x26"x34"-I.D.

DATE

DRAWN BY

DRAWING NO.

1/16

CLASSIC DESIGN

10 - 1826