



PLAN VIEW



DETAIL OF OPENING

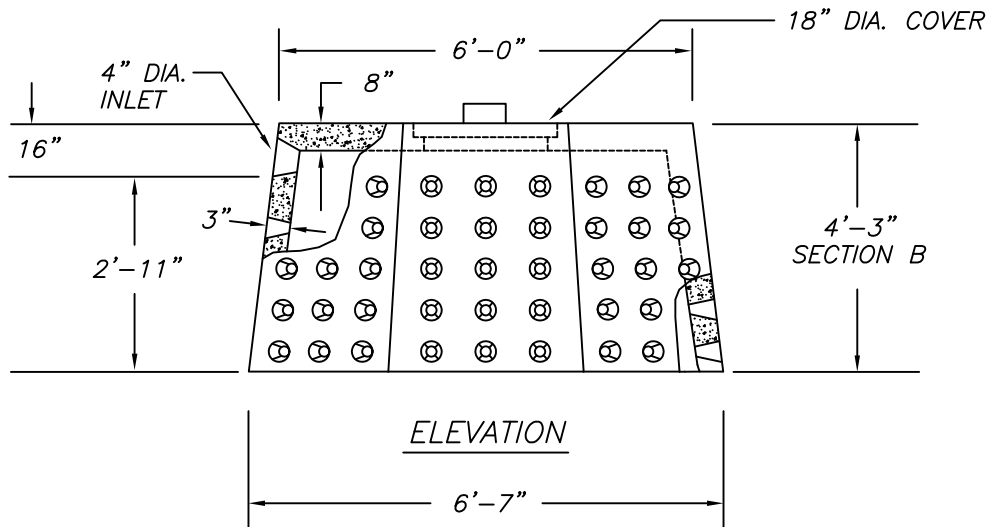

**NOTES :**

- \* CONCRETE TO TEST 4000 PSI @ 28 DAYS
- \* STEEL REINFORCEMENT-ASTM-A-615
- \* SECTION B - 630 GALLONS 6'-7" ACROSS BOTTOM WEIGHT - 3,000 LBS.
- \* LOAD RATING - HS20

|   |                |             |
|---|----------------|-------------|
| Precast Manufacturing Co. , LLC             |                |             |
| 187 Strykers Road Phillipsburg , N.J. 08865 |                |             |
| Tel. (908) 454-2122 - Fax (908) 454-0512    |                |             |
| CONT.                                       |                |             |
| JOB   |                |             |
| SECTION B DRYWELL 630 GALLONS               |                |             |
| DATE  | DRAWN BY       | DRAWING NO. |
| 1 / 17                                      | CLASSIC DESIGN | 705-B       |